


NOTE: ALL RESTROOMS TO BE HANDICAP ACCESSIBLE PER THE ILLINOIS ACCESSIBILITY CODE - SEE INTERIOR TOILET ELEVATIONS 2/AS

TENANT SEPARATION WALL SHALL BE 2'-0" HIGH, TYPE 'X' 1/2" GYP. BD. BOTH SIDES TO UNDERSIDE OF ROOFDECK (1-HOUR RATED ASSEMBLY U.L. #418) (TYPICAL BETWEEN ALL SPACES)

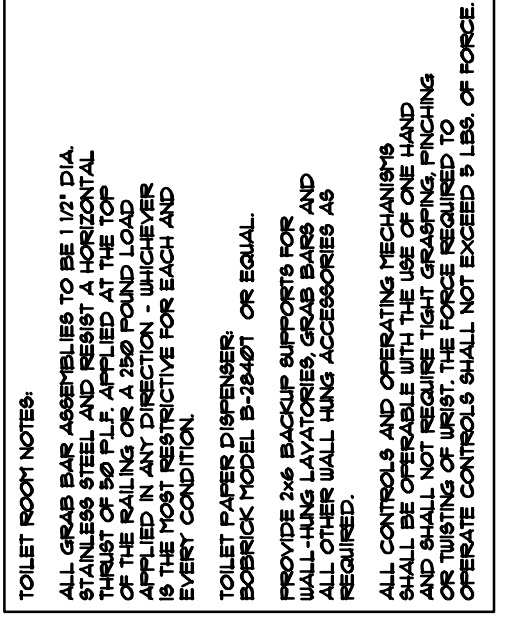


2 INTERIOR TOILET ELEVATIONS
 1/2" = 1'-0"

1 FLOOR PLAN
 1/4" = 1'-0"

DOOR SCHEDULE:

DOOR MARK	DOOR SIZE	MATERIAL TYPE	REMARKS
01	3'-0" x 7'-0" x 13/4"	ALUM.	STOREFRONT W/ TRANSOM + GLOSER
02	3'-0" x 7'-0" x 13/4"	ALUM.	STOREFRONT W/ TRANSOM + GLOSER
03	3'-0" x 7'-0" x 13/4"	ALUM.	STOREFRONT W/ TRANSOM + GLOSER
04	3'-0" x 7'-0" x 13/4"	ALUM.	STOREFRONT W/ TRANSOM + GLOSER
05	3'-0" x 7'-0" x 13/4"	METAL	INSULATED FLUSH
06	3'-0" x 7'-0" x 13/4"	WOOD	FLUSH SOLID CORE W/ GLOSER + PRIVACY LATCH
07	3'-0" x 7'-0" x 13/4"	WOOD	FLUSH SOLID CORE W/ GLOSER + PRIVACY LATCH
08	3'-0" x 7'-0" x 13/4"	METAL	INSULATED FLUSH
09	3'-0" x 7'-0" x 13/4"	METAL	INSULATED FLUSH
10	3'-0" x 7'-0" x 13/4"	WOOD	FLUSH SOLID CORE W/ GLOSER + PRIVACY LATCH
11	3'-0" x 7'-0" x 13/4"	WOOD	FLUSH SOLID CORE W/ GLOSER + PRIVACY LATCH
12	3'-0" x 7'-0" x 13/4"	METAL	INSULATED FLUSH
13	3'-0" x 7'-0" x 13/4"	METAL	FLUSH - PROVIDE STORAGE SPRINKLER/FIRE ALARM BOOT

- DOOR HARDWARE NOTES:
 1. DOOR HANDLES SHALL BE OF THE LEVER TYPE CAPABLE OF OPERATION WITH THE USE OF ONE HAND AND SHALL NOT REQUIRE TIGHT FINCHING, TIGHT GRASPING OR TWISTING OF THE HAND.
 2. THIS TURN DEADBOLTS ARE PROHIBITED. LEVER OR PADDLE DEADBOLTS ARE ACCEPTABLE.
 3. DOOR THRESHOLDS SHALL NOT EXCEED 1/2" IN HEIGHT. THRESHOLDS EXCEEDING 1/4" SHALL BE KEEL TYPE.
 4. DOOR CLOSERS SHALL MEET OPENING FORCE AND SWEEP PERIOD REQUIREMENT.
 5. DOORS LEADING TO POTENTIAL HAZARDOUS AREAS SHALL HAVE KNURLED HANDLES.

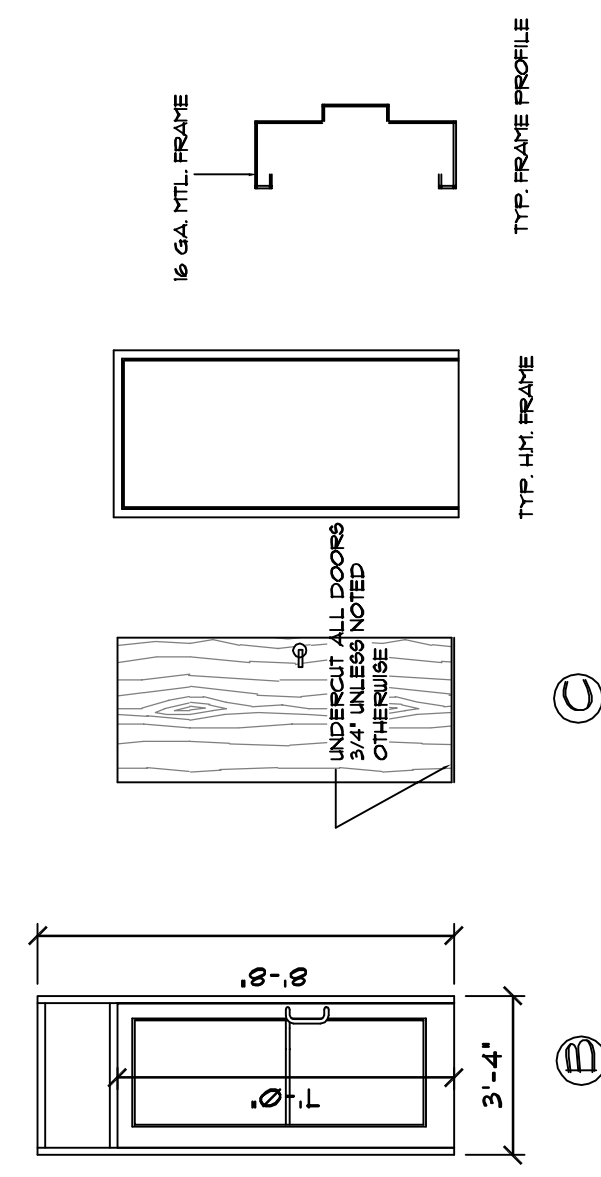

DOOR TYPES

- FRAMING AND DETAIL NOTES:
 1. REFER TO DETAIL SHEET FOR TYPICAL WALL TYPES.
 2. PROVIDE METAL TRIM OR CASING AT ALL EDGES OF DETAIL SURFACES WHERE IT TERMINATES OR MEETS OTHER MATERIAL UNLESS OTHERWISE NOTED.
 3. PROVIDE OTHER METAL CORNER BEAD AT ALL OUTSIDE CORNERS UNLESS OTHERWISE NOTED.
 4. PENETRATIONS OF ONE HOUR WALLS SHALL BE PROTECTED BY ONE HOUR ASSEMBLIES.
 5. CONTRACTOR SHALL PROVIDE AND LOCATE ACCESS PANELS AS REQUIRED AFTER INSTALLATION OF PARTITION WALLS.
 6. PROVIDE BLOCKING BEHIND ALL SIGNS, FIXTURES, ETC. WHERE INDICATED OR REQUIRED.
 7. PROVIDE STIFFENING BRACING, BACK-UP FLATES, ETC. AS REQUIRED AT STUD WALLS FOR SUPPORT OF TOILET FIXTURES OR OTHER EQUIPMENT.
 8. EXTEND ALL STOREFRONT FRAMING TO STRUCTURE ABOVE. DIAGONALLY BRACE AS REQUIRED.

- PLAN GENERAL NOTES:
 1. ALL DOORS TO BE KEYLESS IN THE DIRECTION OF EGRESS.
 2. ALL FIRE RATED DOORS TO BE SELF CLOSING.
 3. ALL GLAZED DOORS AND ANY GLAZED PANELS MORE THAN 18" IN WIDTH ADJACENT TO ANY DOOR SHALL BE SELF CLOSING.
 4. ALL INTERIOR FINISHES TO BE CLASS A WITH FLAME SPREAD RATING OF 0-25.
 5. SEE MECHANICAL DRAWINGS FOR LIGHT AND VENT SCHEDULES.
 6. DO NOT FASTEN STUDS OR GYP. BD. TO TOP RANER OF NON-BEARING GYP. BD. PARTITIONS. CUT STUDS AND GYP. BD. SHORT TO ALLOW FOR VERTICAL SLAB DEFLECTION.
 7. ALL DIMENSIONS TO BE FACE OF STUDS UNLESS OTHERWISE NOTED.
 8. APPROVE ALL CEILING HEIGHTS WITH BUILDING SYSTEMS. OWNER TO APPROVE ALL CEILING HEIGHTS PRIOR TO INSTALLATION.